



AHMEDABAD MUNICIPAL CORPORATION  
MAHANAGAR SEVA SADAN  
**CENTRAL LABORATORY**  
(An ISO 9001: 2015 Accredited Laboratory)



Lic No QAC/R91/4650

Dudheshwar Water Works Compound, Dudheshwar, Ahmedabad-380 004, Gujarat, India  
E-mail: [centrallab@ahmedabadcity.gov.in](mailto:centrallab@ahmedabadcity.gov.in), Phone No-(079) 25631105, 25630438.

June 02, 2025.

To,  
The Principal,  
Sant Kabir High School, B/h H.L. College of Commerce,  
Navrangpura, Ahmedabad - 380009

Dear Sir,

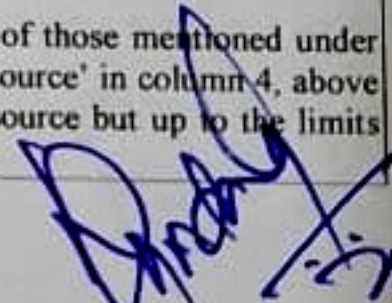
We have analyzed your water samples collected on Dt. 21-05-2025 for the following **Chemical and Bacteriological** parameters. The analysis report is as hereunder.

| Sr. No. | Parameter                                           | Requirement (Acceptable Limit)               | Permissible Limit in the Absence of Alternate Source | Sample Value   |
|---------|-----------------------------------------------------|----------------------------------------------|------------------------------------------------------|----------------|
|         |                                                     | As per IS-10500-2012                         |                                                      |                |
| A.      | Organoleptic and Physical Parameters                |                                              |                                                      |                |
| 1       | Colour, Hazen units, Max                            | 5                                            | 15                                                   | 0.1            |
| 2       | pH value                                            | 6.5-8.5                                      | No relaxation                                        | 7.2            |
| 3       | Turbidity, NTU, Max                                 | 1                                            | 5                                                    | 0.1            |
| 4       | Total dissolved solids, mg/l, Max                   | 500                                          | 2000                                                 | 126            |
| B.      | General Parameters                                  |                                              |                                                      |                |
| 1       | Total hardness (as CaCO <sub>3</sub> ), mg/l, Max   | 200                                          | 600                                                  | 20             |
| 2       | Calcium (as Ca), mg/l, Max                          | 75                                           | 200                                                  | 4              |
| 3       | Magnesium (as Mg), mg/l, Max                        | 30                                           | 100                                                  | 2.44           |
| 4       | Chloride (as Cl), mg/l, Max                         | 250                                          | 1000                                                 | 25             |
| 5       | Sulphate (as SO <sub>4</sub> ) mg/l, Max            | 200                                          | 400                                                  | 8.2            |
| 6       | Total alkalinity (as CaCO <sub>3</sub> ), mg/l, Max | 200                                          | 600                                                  | 60             |
| 7       | Free residual chlorine, mg/l, Min                   | 0.2                                          | 1.0                                                  | Nil            |
| C.      | Bacteriological Quality of Drinking Water           |                                              |                                                      |                |
| 1       | Total Coliform bacteria, MPN/100 ml.                | Shall not be detectable in any 100 ml sample | Shall not be detectable in any 100 ml sample         | Not Detectable |
| 2       | E. coli, MPN/100 ml                                 | Shall not be detectable in any 100 ml sample | Shall not be detectable in any 100 ml sample         | Not Detectable |

**Remarks:**

- The Central Laboratory, AMC, has collected the samples.
- The result contained in this report relate only to the sample material tested.
- The report is not being reproduce wholly or in part and cannot be used as evidence in the court of law and should not be used in any advertising media without our special permission in writing.

NOTE — It is recommended that the acceptable limit is to be implemented. Values in excess of those mentioned under 'acceptable' render the water not suitable, but still 'permissible limit in the absence of alternate source' in column 4, above which the sources will have to be rejected. May be tolerated in the absence of an alternative source but up to the limits indicated.

  
Scientist In-Charge  
Central Laboratory

# Ahmedabad Municipal Corporation



Sr. No. 85



Health Department

## SANITARY CONVENIENCE CERTIFICATE

A Certificate for Sanitary Convenience is issued to the Manager / Secretary

/ Organiser of the Talks / Theatre namely ST. KABIR HIGH SCHOOL

VISHESH TANDAN Situated

at 014 H.L. college of Commerce, Navrangpura, Ahmedabad

for the period of 12 months / Days i. e. from 01.01.25 to

31.12.25 200

Date : 17/4/25

"Issued Subject to NOC from other Concerned departments".

Copy to :-

1. The Manager / Secretary
2. The Commissioner of Police Ahmedabad.

Rs. 1000/-

17/4/25  
1196/49

Dy./Add. Medical Officer, Health  
Municipal Corporation, Ahmedabad.

[Signature]  
Dy. Director  
(S.W.M. West Zone)